




10-12kVA Bonus switchgear offer

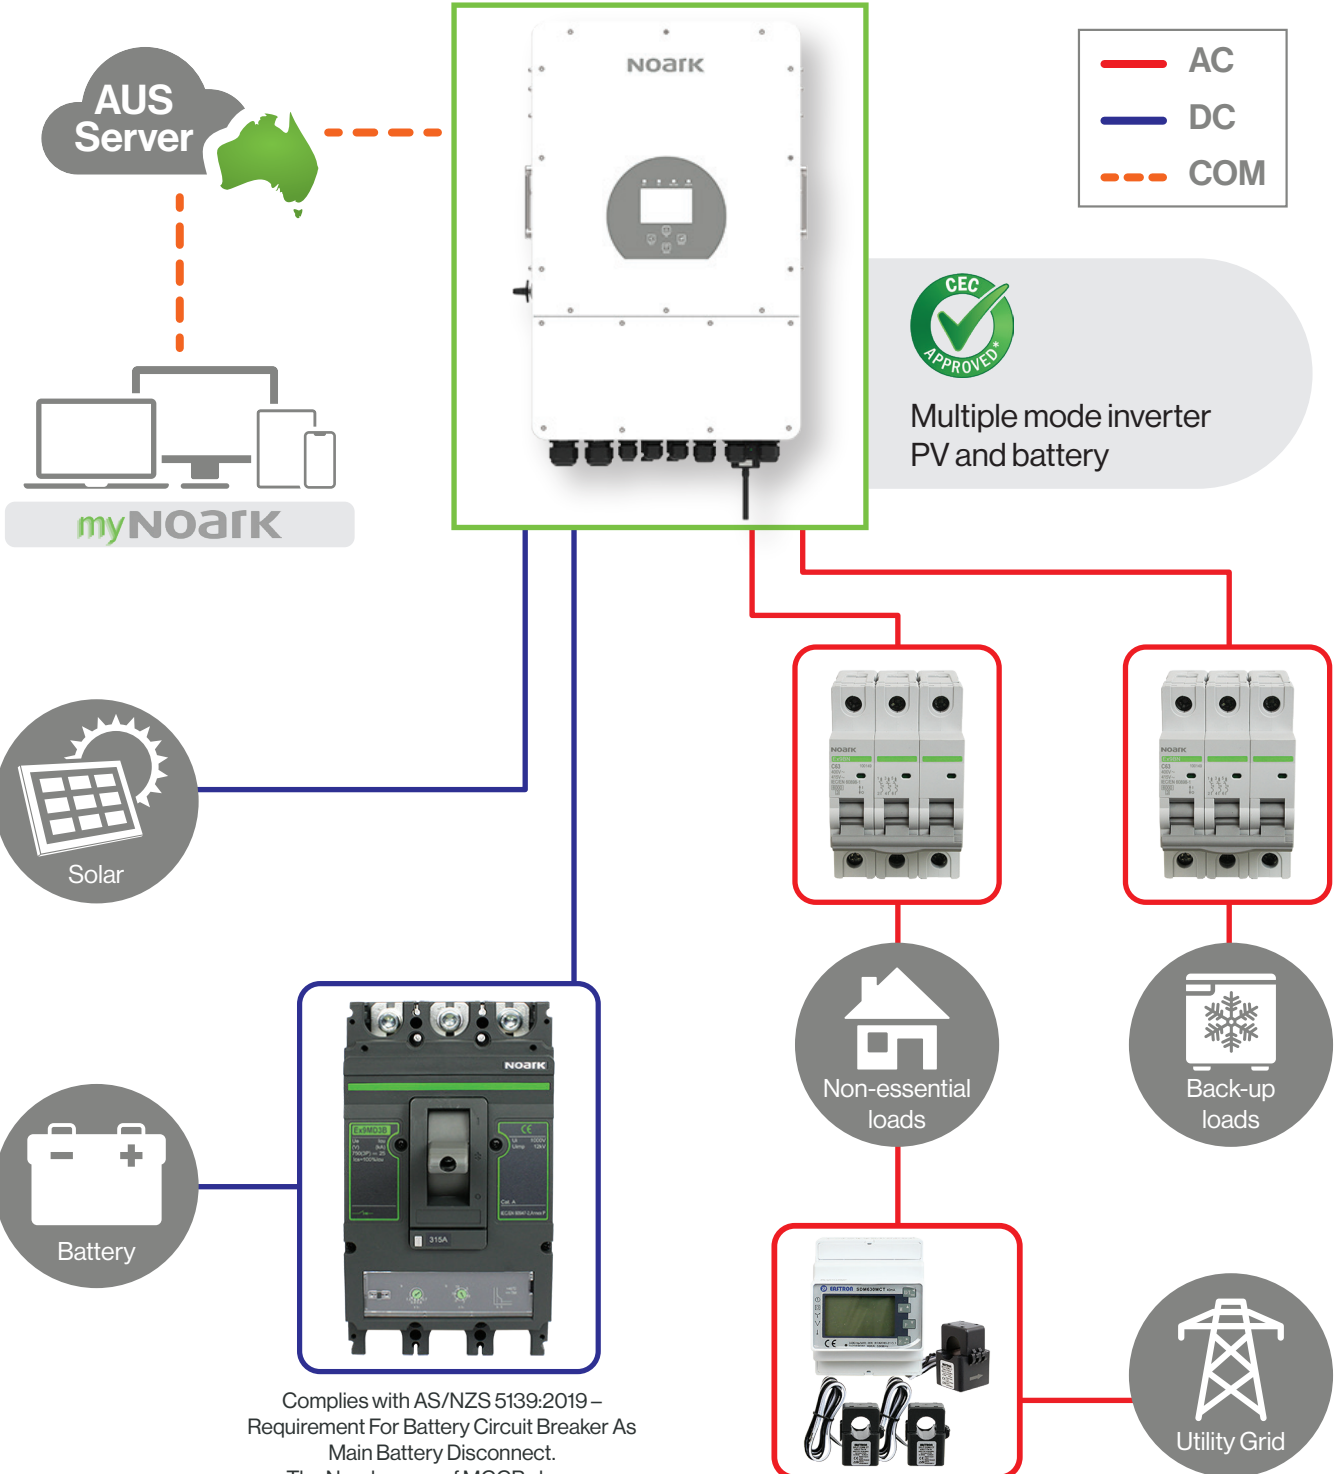

Complies with AS/NZS 5139:2019 – Requirement For Battery Circuit Breaker As Main Battery Disconnect.
 The Noark range of MCCBs has an adjustable rated current range (70, 80, 90 or 100% of Nominal rating) which gives flexibility for various battery sizing.

Energy Meter
 1. More accurate and faster responding than CT.
 2. Avoid voltage segregation or length extension.