Noark

EMPOWERING SUSTAINABILITY

5/6/8kVA Bonus switchgear offer

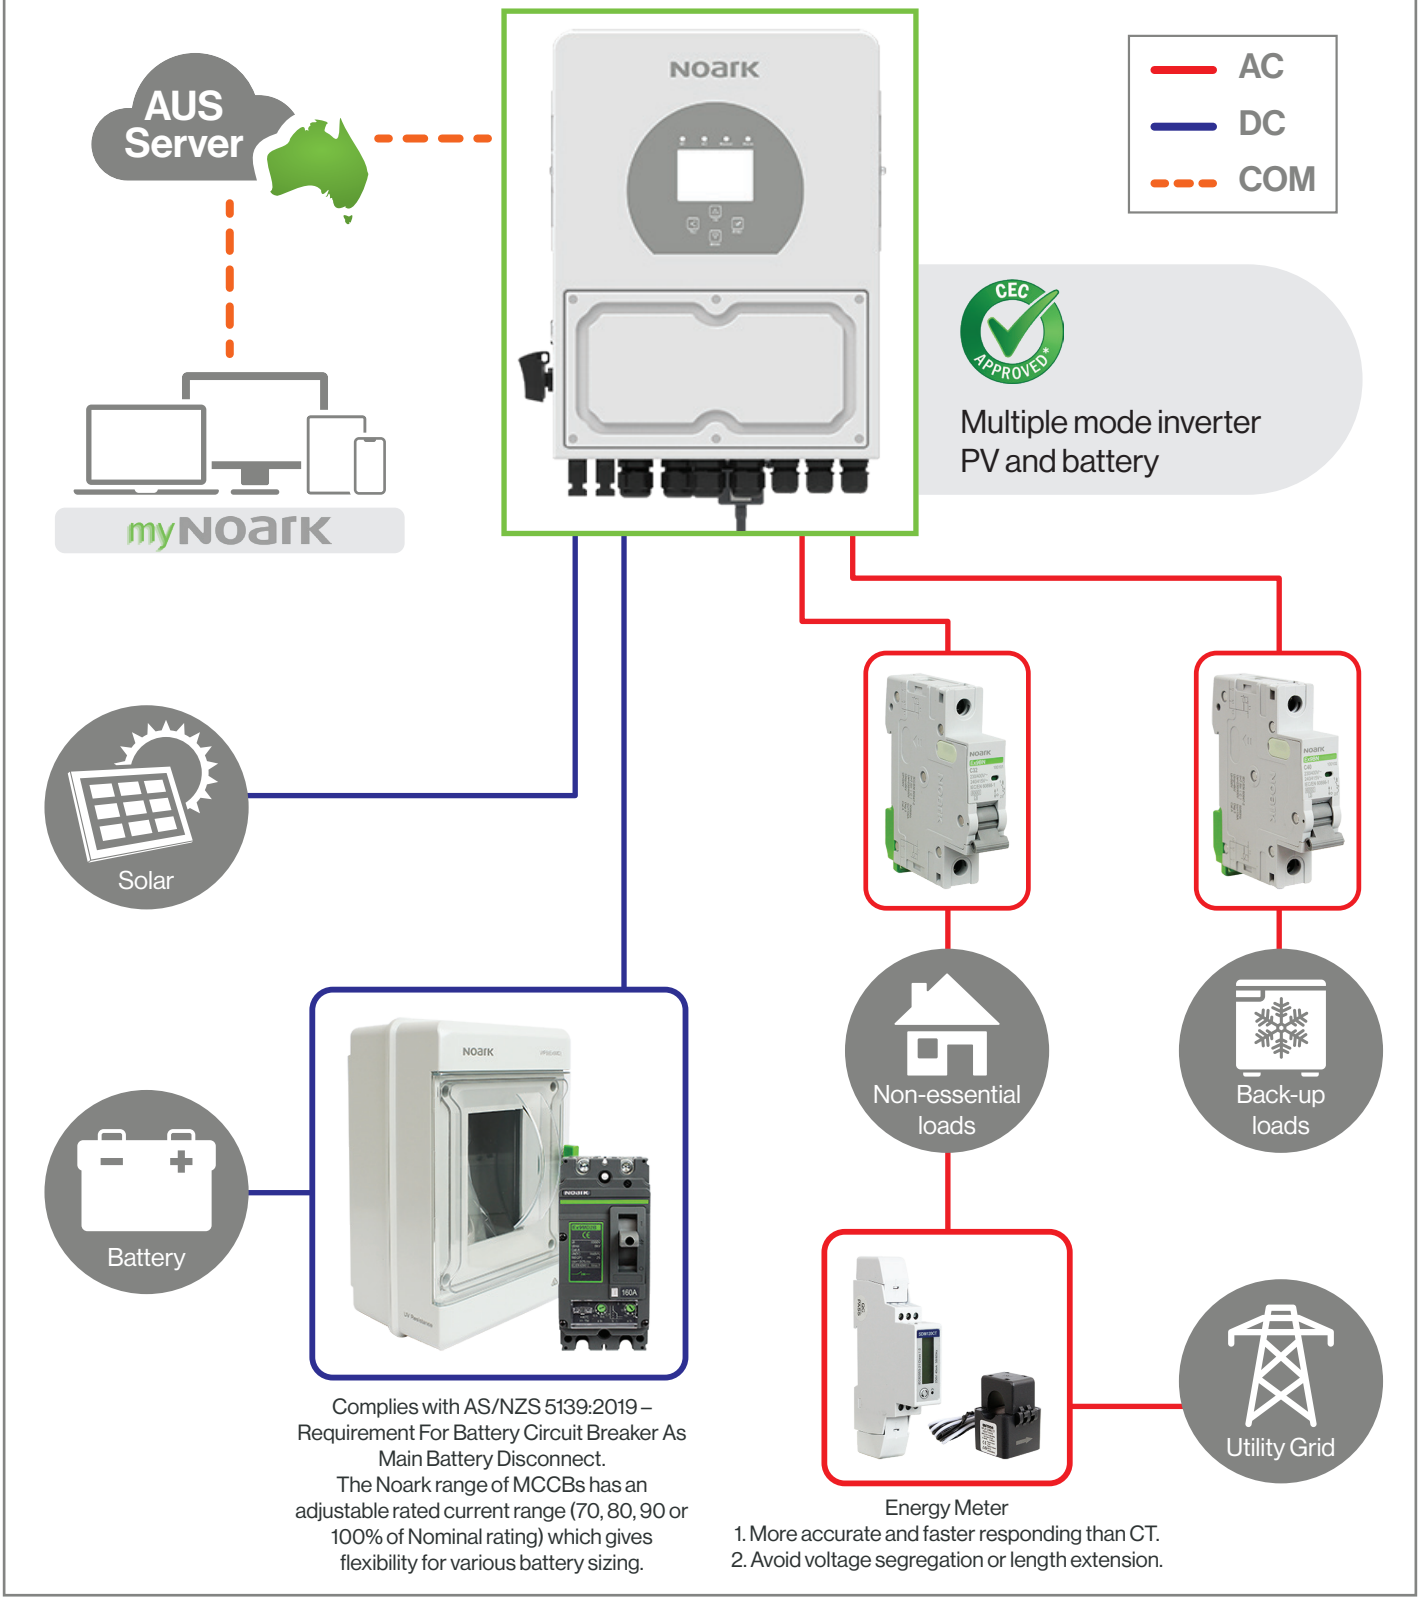

Complies with AS/NZS 5139:2019 – Requirement For Battery Circuit Breaker As Main Battery Disconnect.
The Noark range of MCCBs has an adjustable rated current range (70, 80, 90 or 100% of Nominal rating) which gives flexibility for various battery sizing.

Energy Meter
1. More accurate and faster responding than CT.
2. Avoid voltage segregation or length extension.

BATTERY ENGINEERING

Official Australian Noark Distribution Partner